
# **BEEF COW PROTOCOLS - 2013**

## **HEAT DETECTION**

### **Select Synch**




#### **Select Synch + CIDR®**



#### PG 6-day CIDR®


Heat detect and AI days 0 to 3. Administer CIDR to non-responders and heat detect and AI days 9 to 12. Protocol may be used in heifers.



## FIXED-TIME AI (TAI)\*


### 7-day CO-Synch + CIDR®

Perform TAI at 60 to 66 hr after PG with GnRH at TAI.



### 5-day CO-Synch + CIDR®

Perform TAI at  $72 \pm 2$  hr after CIDR removal with GnRH at TAI. Two injections of PG  $8 \pm 2$  hr apart are required for this protocol.

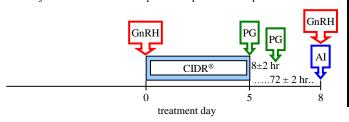

# HEAT DETECT & TIME AI (TAI)

#### **Select Synch & TAI**

Heat detect and AI day 6 to 10 and TAI all non-responders
72 – 84 hr after PG with GnRH at TAI.

GnRH

GnRH

O

treatment day


GnRH

O

treatment day


### **Select Synch + CIDR® & TAI**

Heat detect and AI day 7 to 10 and TAI all non-responders 72 - 84 hr after PG with GnRH at TAI.



#### PG 6-day CIDR® & TAI

Heat detect & AI days 0 to 3. Administer CIDR to non-responders & heat detect and AI days 9 to 12. TAI non-responders 72 - 84 hr after CIDR removal with GnRH at AI. Protocol may be used in heifers.




# FIXED-TIME AI (TAI)\*

for Bos indicus-influenced cows only

### PG 5-day CO-Synch + CIDR®

Perform TAI at  $66 \pm 2$  hr after CIDR removal with GnRH at TAI. Two injections of PG  $8 \pm 2$  hr apart are required for this protocol.

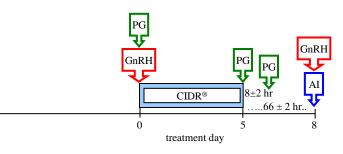


\* The time listed for <u>"Fixed-time AI"</u> should be considered as the approximate average time of insemination. This should be based on the number of cows to inseminate, labor, and facilities.




Cystorelin®, Factrel®, Fertagyl®, OvaCyst®

estroPLAN®, Estrumate®, In-Synch®, Lutalyse®, ProstaMate®

# **BEEF HEIFER PROTOCOLS - 2013**

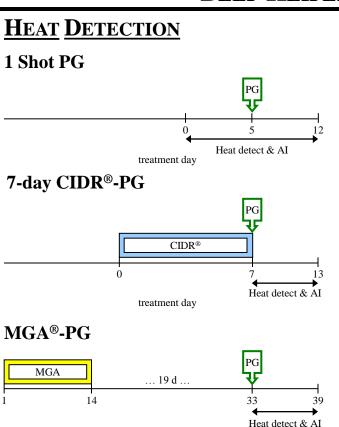


treatment day

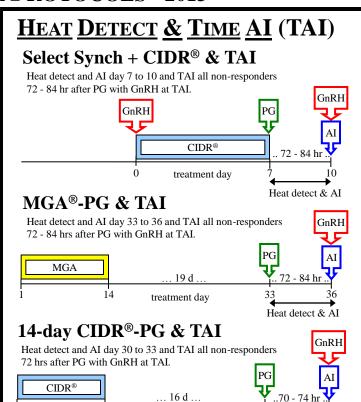

treatment day

Heat detect & Al

## FIXED-TIME AI (TAI)\*

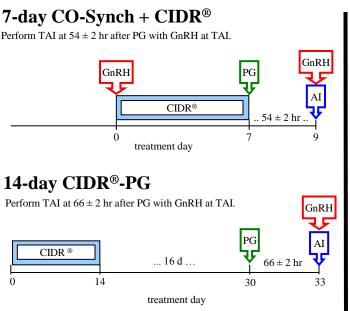

MGA®-PG

Perform TAI at  $72 \pm 2$  hr after PG with GnRH at TAI.

14



\* The times listed for "<u>Fixed-time AI</u>" should be considered as the approximate average time of insemination. This should be based on the number of heifers to inseminate, labor, and facilities.



Cystorelin®, Factrel®, Fertagyl®, OvaCyst®

estroPLAN®, Estrumate®, In-Synch®, Lutalyse®, ProstaMate®